



Contents lists available at ScienceDirect

Computers and Chemical Engineering

journal homepage: www.elsevier.com/locate/compchemeng



Optimal operation of heat exchanger networks with stream split: Only temperature measurements are required

Johannes Jäschke, Sigurd Skogestad*

Department of Chemical Engineering, Norwegian University of Science and Technology (NTNU), N-7491 Trondheim, Norway

ARTICLE INFO

Article history:

Received 17 September 2013
Received in revised form 20 March 2014
Accepted 27 March 2014
Available online xxx

Keywords:

Heat exchanger networks
Parallel systems
Self-optimizing control
Optimal operation

ABSTRACT

For heat exchanger networks with stream splits, we present a simple way of controlling the split ratio. We introduce the “Jäschke Temperature”, which for a branch with one exchanger is defined as $T_J = (T - T_0)^2 / (T_h - T_0)$, where T_0 and T are the inlet and outlet temperatures of the split stream (usually cold), and T_h is the inlet temperature of the other stream (usually hot). Assuming the heat transfer driving force is given by the arithmetic mean temperature difference, the Jäschke Temperatures of all branches must be equal to achieve maximum heat transfer. The optimal controlled variable is the difference between the Jäschke Temperatures of each branch, which should be controlled to zero. Heat capacity or heat transfer parameters are not needed, and no optimization is required to find the optimal setpoints for the controlled variables. Most importantly, our approach gives near-optimal operation for systems with logarithmic mean temperature difference as driving force.

© 2014 Elsevier Ltd. All rights reserved.

1. Introduction

Global climate challenges and competition require efficient energy usage, and this typically implies re-using energy as much as possible. In the chemical and process industries, large amounts of energy can be saved by heat recovery in heat exchanger networks, which transfer energy in form of heat from a set of hot streams to a set of cold streams. By optimizing layout and operation of these heat exchanger networks, the overall consumption of natural resources for heating and cooling can be reduced considerably. In addition, this often results in significantly reduced operating costs.

The potential of heat exchanger networks for saving energy and costs has led to a large body of research, and most of the literature falls into one of two categories. The first category deals with the *design and synthesis* of heat exchanger networks (see e.g. Linnhoff and Flower, 1978; Linnhoff and Hindmarsh, 1983; Saboo and Morari, 1984; Saboo et al., 1985; Colberg and Morari, 1990; Yee and Grossmann, 1990; Gundersen et al., 1997; Furman and Sahinidis, 2002; Laukkanen et al., 2010). Most literature contributions belong to this category, where some likely conditions and scenarios are assumed, and the task is to find the optimal type, size, and structure of interconnections of the heat exchangers.

Generally this results in large mixed integer optimization problems, and much of the literature addresses the issue of finding optimal solutions in an efficient way. Once the network structure and the size of the heat exchangers are decided, they either cannot be changed at all at a later point in time, or only at a high cost. The design step is therefore very important for the efficiency of the network.

The second category, where this work is placed in, deals with optimal *operation* of heat exchanger networks (Aguilera and Marchetti, 1998; Glemmestad et al., 1999; Roderer et al., 2003; Lersbamrungsuk et al., 2008). This category is complementary to the first one, as a good design does not imply good operation in terms of the benefits being actually achieved. In particular, finding optimal process operation strategies is important, because the conditions in the real plant generally differ from those assumed during the design stage. Even if the actual operating conditions are the same as assumed during plant design, Jensen and Skogestad (2008) showed that because of simplifying assumptions during design, like fixing the minimum temperature difference ΔT_{min} to 10 K, the optimal design point is often not the same as the optimal operating point. The contributions from this second category study how the available degrees of freedom, such as valves, bypasses and utility heaters, can be used to optimally match the real operating conditions and constraints. Although there has been some research activity in this area, there is still a need for simple methods to optimize operation of heat exchanger networks. The objective of

* Corresponding author. Tel.: +47 735 94154.
E-mail address: skoge@ntnu.no (S. Skogestad).

this paper is therefore to provide an approach which leads to near-optimal operation of certain heat exchanger networks.

When implementing optimal operation in a process, such as heat exchanger networks, there are two fundamental model-based approaches which can be taken: Online optimization and offline optimization. In online optimization (Grötschel et al., 2001), the model is used to formulate an optimization problem, which is repeatedly solved online in a fast optimization software. The optimal input values obtained from the software are then applied to the plant. In this approach, the plant measurements are primarily used for adjusting model parameters, such that the model and the plant match. This approach may be implemented using a steady state model (Marlin and Hrymak, 1997; Lid et al., 2001), or alternatively a dynamic model (Grötschel et al., 2001). Implementing online optimization is relatively expensive due to the high costs of obtaining and maintaining a good process model, which can be optimized in real-time. However, if a good model is available, this approach can yield results which are very close to the true optimum. Due to the high costs, it is mainly implemented in cases where the immediate economic benefits are very high, such as refineries.

The alternative offline optimization approach exploits the structure of the optimal solution. This results in simple operating schemes which do not require online solution of optimization problems. The basic idea was first conceived by Morari et al. (1980), who write that “we want to find a function c of the process variables [...] which when held constant, leads automatically to the optimal adjustment of the manipulated variables, and with it, the optimal operating conditions.” This idea has been followed in the paradigm of self-optimizing control, where such variables are found in a systematic manner, and in NCO-tracking, where these variables are the necessary optimality conditions (NCO) (Mathisen et al., 1992; Skogestad, 2000; Srinivasan and Bonvin, 2004; Lersbamrungsuk et al., 2008; Jäschke and Skogestad, 2011, 2012a). Although typically some degree of sub-optimality will have to be tolerated, these approaches are attractive in practice, because they are simple and easy to implement.

Considering the structure of the optimal solution, the steady state optimal operating point of heat exchanger networks without stream splits and with only single bypasses and utilities as manipulated variables, is characterized by being at constraints (Aguilera and Marchetti, 1998; Lersbamrungsuk et al., 2008), and can be described by a linear programming problem. In this case all degrees of freedom are used to specify target temperatures or are kept at constraints (e.g. bypass valves are used to control a target temperature, or are either fully open or fully closed). The problem of optimal operation is then reduced to finding and tracking the set of active constraints (Lersbamrungsuk et al., 2008), which often can be done without online optimization.

In this paper we study heat exchanger networks with stream splits, where the steady state optimal operating point is generally unconstrained. A simple example for such a system is shown in Fig. 1, where a cold stream F_0 is split into two branches, which each are heated individually by hot streams.

The operational objective is to maximize the total heat transfer, or equivalently to maximize the temperature after mixing, T_{end} . Here, the split fraction must be continuously adapted to match varying operating conditions such as changing inlet temperatures ($T_0, T_{h1,1}, T_{h1,2}$), flow rates ($F_0, F_{h1,1}, F_{h1,2}$), and heat transfer properties ($UA_{1,1}, UA_{1,2}$). In practice, these cases are either handled by an online optimization approach (Lid et al., 2001), when the potential savings are very high, or simply operated in an open-loop fashion, where the split ratio is set to some constant. Other ad-hoc solutions include isothermal mixing and controlling some outlet temperatures to a setpoint. These solutions are suboptimal.

The contribution of this paper is to present a simple method for optimizing operation of heat exchanger networks with stream

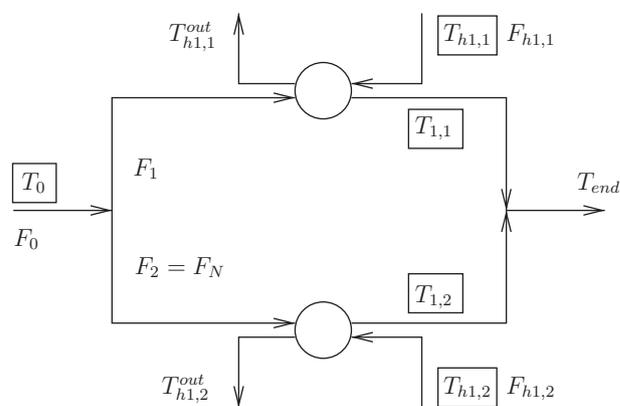


Fig. 1. Simple heat exchanger network with one split. The boxed variables are needed for obtaining the Jäschke Temperatures.

splits. For each branch we define a “Jäschke Temperature”, and near-optimal operation is achieved by adjusting the split between the branches in such a way that the Jäschke Temperatures of all branches are equal. The results have been submitted for patenting (Jäschke and Skogestad, 2012c). Nevertheless, the derivation is of interest for the scientific community and deserves the separate discussion provided in this paper. Our paper also fits nicely into this Morari special issue, because of his early important work on heat exchanger networks (Saboo and Morari, 1984) and optimal operation (Morari et al., 1980).

To obtain our results, we follow the general approach described by Jäschke and Skogestad (2012b): We set up a simple model, formulate the optimality conditions, and then eliminate the unmeasured variables from the optimality conditions. The obtained expression is a function of measurements only, and controlling it is equivalent to controlling the optimality conditions.

Note that the results in this paper also are applicable when a hot stream is split into parallel streams which are cooled down individually. To simplify the presentation, however, we present only the case, where the parallel streams are heated.

This paper is organized as follows: In Section 2 we provide relevant background material on optimality conditions for parallel systems, and Section 3 describes the network topology and heat exchanger model used in this work. The main results are presented in Section 4, and Section 5 contains some case studies to demonstrate the applicability of our results. Finally, the paper is closed with a discussion and conclusions in Sections 6 and 7.

2. Optimality conditions for parallel systems

Let us start by considering a smooth general optimization problem. After the active constraints are satisfied (e.g. by control) we can describe optimal operation as an unconstrained optimization problem,

$$\min_u J(u). \quad (1)$$

Here $u \in \mathbb{R}^{n_u}$ denotes the unconstrained degrees of freedom. To fully specify operation, we need as many controlled variables c as there are degrees of freedom u , $n_c = n_u$.

Consider now a system with the topology given in Fig. 2, with N parallel streams F_j which are branched off a given common feed stream F_0 . The total operating cost J of the system is assumed to be the sum of the individual scalar costs J_j from each line j ,

$$J = \sum_{j=1}^N J_j(F_j), \quad (2)$$

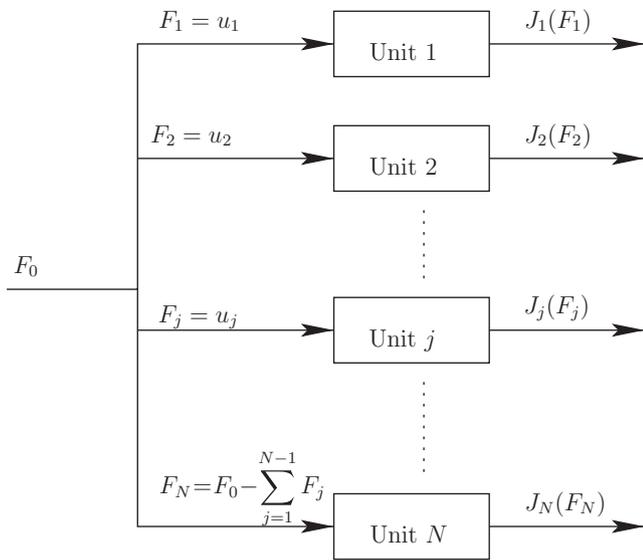


Fig. 2. Parallel units connected to a common stream. Each unit j has an associated load-dependent operating cost $J_j(F_j)$.

and the operational objective is to distribute the streams F_j such that the total operating cost J is minimized. Since all streams F_j are coming from one overall feed stream F_0 , conservation of mass requires a common coupling constraint,

$$F_0 - \sum_{j=1}^N F_j = 0. \tag{3}$$

Because of this coupling constraint, only $N-1$ streams can be adjusted independently. The N -th flow rate is given by the mass balance, $F_N = F_0 - \sum_{j=1}^{N-1} F_j$.

Now let

$$u = [F_1, F_2, \dots, F_{N-1}]^T$$

denote the degrees of freedom. Adjusting one flow to decrease the cost in one branch will eventually cause the cost of another branch to become unacceptably high. Therefore, this class of systems exhibits an unconstrained optimum, and under a suitable second order condition, the ideal controlled variable is the gradient, which must be controlled to zero for optimality, (Halvorsen and Skogestad, 1997; Bonvin et al., 2001)

$$c = J_u = \frac{\partial J}{\partial u} = 0. \tag{4}$$

The result summarized in the following theorem is an important component for obtaining simple controlled variables for parallel systems.

Theorem 1 (e.g. Downs and Skogestad (2011)). For a parallel system as in Fig. 2, the optimality condition can be written as

$$\frac{\partial J_1}{\partial F_1} = \frac{\partial J_2}{\partial F_2} = \dots = \frac{\partial J_j}{\partial F_j} = \dots = \frac{\partial J_N}{\partial F_N}, \tag{5}$$

which leads to the optimal controlled variable

$$c = J_u = \begin{pmatrix} \frac{\partial J_1}{\partial F_1} - \frac{\partial J_N}{\partial F_N} \\ \frac{\partial J_2}{\partial F_2} - \frac{\partial J_N}{\partial F_N} \\ \vdots \\ \frac{\partial J_j}{\partial F_j} - \frac{\partial J_N}{\partial F_N} \\ \vdots \\ \frac{\partial J_{N-1}}{\partial F_{N-1}} - \frac{\partial J_N}{\partial F_N} \end{pmatrix}, \tag{6}$$

which must be controlled to zero.

Proof. Assume the $N-1$ degrees of freedom are chosen as the flows in branches 1 to $N-1$. Then a flow change in any branch $j = 1 \dots N-1$ is compensated by a change of flow in branch N , so we have

$$\delta F_N = -\delta F_j \quad \text{for } j \neq N. \tag{7}$$

The change δJ in the cost for a variation in δF_j is

$$\frac{\delta J}{\delta F_j} = \frac{\delta(J_1 + J_2 + \dots + J_j + J_N)}{\delta F_j} = \frac{\delta(J_j + J_N)}{\delta F_j},$$

using (7), this becomes

$$\frac{\partial J}{\partial F_j} = \frac{\partial J_j}{\partial F_j} - \frac{\partial J_N}{\partial F_N}. \tag{8}$$

The fact that this is required to hold for all degrees of freedom $j = 1 \dots N-1$, leads to (5), and the optimal controlled variable (6) follows trivially. □

Theorem 1 states that the marginal costs $\partial J_j / \partial F_j$ must be equal for all lines. Each marginal cost is associated with its own line j , and contains only variables from line j . This structure can be exploited for breaking down the large problem into smaller problems, where unknown variables can be eliminated from the gradient expression. Moreover, since the optimality condition can be written as a pairwise condition (6), we can without loss of generality, consider a system with only two branches.

3. Parallel heat exchanger systems

In this section we present the heat exchanger network model, together with the main assumptions used for deriving our results. Moreover, we introduce the cost function that we want to optimize.

3.1. Heat exchanger network model

We consider a heat exchanger network with N parallel lines. A line j is assumed to have M_j heat exchangers, as illustrated in Fig. 3. For heat exchanger i on line j , $T_{i,j}$, $T_{hi,j}$, $T_{hi,j}^{out}$ denote the cold stream temperature after heat exchanger, the hot inlet temperature, and the outlet temperature of the hot stream, respectively.

Before we proceed with the model equations, we present some assumptions our model is based on.

Assumption 1 (Single phase). There is no phase change in the heat exchangers.

Assumption 2 (Constant heat capacity). The specific heat capacity c_p of the fluids is constant.

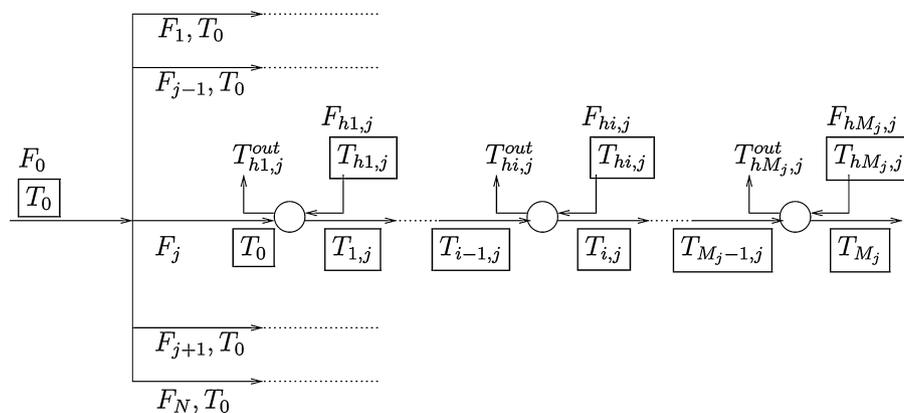


Fig. 3. Detail of a heat exchanger network with N lines and with M_j heat exchangers on line j . The boxed temperatures are needed for obtaining the Jäschke Temperatures.

To simplify notation, we introduce the heat capacities w of the cold and hot streams,

$$w_j = F_j c_{p0}$$

$$w_{hi,j} = F_{hi,j} c_{phi,j}$$

An energy balance around the hot and cold stream of heat exchanger i on line j yields

$$Q_{i,j} = w_i(T_{i,j} - T_{i-1,j}) \quad (9)$$

$$Q_{i,j} = w_{hi,j}(T_{hi,j} - T_{i-1,j}^{out}), \quad (10)$$

where $Q_{i,j}$ denotes the heat transferred in the heat exchanger i on line j . The amount of transferred heat is given by

$$Q_{i,j} = UA_{i,j} \Delta T_{Di,j},$$

where $UA_{i,j}$ denotes the product of heat transfer area and overall heat transfer coefficient, and $\Delta T_{Di,j}$ denotes the driving force. Typically, the driving force is modeled as the logarithmic mean temperature

$$\Delta T_{Di,j} = \Delta T_{\log,i,j} = \frac{(T_{hi,j} - T_{i,j}) - (T_{hi,j}^{out} - T_{i-1,j})}{\log[(T_{hi,j} - T_{i,j}) / (T_{hi,j}^{out} - T_{i-1,j})]}. \quad (11)$$

When the heat capacity of the hot and the cold streams have similar magnitude, the arithmetic mean temperature is a good approximation of the logarithmic mean temperature

$$\Delta T_{Ai,j} = \frac{(T_{hi,j} - T_{i,j}) + (T_{hi,j}^{out} - T_{i-1,j})}{2} \approx \Delta T_{\log,i,j}. \quad (12)$$

This approximation has an error of less than 1% (Skogestad, 2008) when the temperature difference between the streams on the two sides of the heat exchanger are within $\pm 40\%$, that is when

$$\frac{1}{\sqrt{2}} \leq \frac{\Delta T_{i,j}^{(1)}}{\Delta T_{i,j}^{(2)}} \leq \sqrt{2}.$$

Here $\Delta T_{i,j}^{(1)}$ is the temperature difference between the hot and cold stream on one side of the heat exchanger, and $\Delta T_{i,j}^{(2)}$ is the temperature difference on the other side.¹ To be able to derive simple results, we make the following additional assumption:

Assumption 3 (Arithmetic mean temperature driving force). The driving force for heat transfer is given by the arithmetic mean temperature difference.

¹ For example, for a counter current heat exchanger using the notation in Fig. 3, we have $\Delta T_{i,j}^{(1)} = T_{hi,j}^{out} - T_{i-1,j}$ and $\Delta T_{i,j}^{(2)} = T_{hi,j} - T_{i,j}$.

The stream splitter is described by a simple mass balance,

$$w_0 - \sum_{j=1}^N w_j = 0,$$

and the energy balance yields

$$T_{0,j} = T_0 \quad \text{for all } j.$$

In the case of the cold streams being merged again after passing through the heat exchangers, using the energy balance, the end temperature out of the mixer can be calculated by the weighted sum of the temperatures of the individual lines,

$$T_{end} = \frac{1}{w_0} \sum_{j=1}^N w_j T_{M_j}.$$

3.2. Objective function

Our goal is to adjust the splits between the lines of the heat exchanger network such that the operating cost J is minimized. In a general form we may write the cost J as

$$J = -income + expenses.$$

We denote the price that has to be paid for transferring heat in heat exchanger i on line j as $p_{i,j}^{cost}$. Similarly, the price for the added value is denoted $p_{i,j}^{rev}$. The cost thus becomes

$$J = - \sum_{j=1}^N \sum_{i=1}^{M_j} p_{i,j}^{rev} Q_{i,j} + \sum_{j=1}^N \sum_{i=1}^{M_j} p_{i,j}^{cost} Q_{i,j} = - \sum_{j=1}^N \sum_{i=1}^{M_j} (p_{i,j}^{rev} - p_{i,j}^{cost}) Q_{i,j}. \quad (13)$$

In practice, the prices $p_{i,j}^{rev}$ will often be equal, $p_{i,j}^{rev} = p^{rev}$, while the prices for using different hot streams $p_{i,j}^{cost}$ may differ significantly. By defining a new price $p_{i,j} = p_{i,j}^{rev} - p_{i,j}^{cost}$ we may simplify the cost function to

$$J = - \sum_{j=1}^N \sum_{i=1}^{M_j} p_{i,j} Q_{i,j}. \quad (14)$$

When all prices for using the hot streams are equal, $p_{i,j}^{cost} = p^{cost}$, and the prices for the heated streams are equal, $p_{i,j}^{rev} = p^{rev}$, this is equivalent to maximizing the total heat transfer. Furthermore, if

the branches are merged again, it corresponds to maximizing the end temperature T_{end} .

4. Controlled variables for heat exchanger networks with splits

When setting up the optimality conditions for a heat exchanger network, the expressions will generally contain all variables. Some variables may be easy to measure, such as temperatures, while others are more difficult to measure or estimate, such as heat capacities and heat transfer coefficients. Our goal is to find controlled variables, which are functions of measurements that are easy to obtain, and are equivalent to controlling the gradient to zero.

We state the main results in this section, and present their derivation in Appendix A. For convenience, we first introduce the shifted temperature θ , which is formed by subtracting the feed temperature T_0 ,

$$\theta = T - T_0. \quad (15)$$

Theorem 2 (Maximize heat transfer). *Under Assumptions 1–3, and equal prices $p_{i,j} = 1$ in the cost function (14), the marginal costs for each branch $j = 1 \dots N$ can be expressed as*

$$\frac{\partial J}{\partial w_j} = T_{j,j} \quad (16)$$

where $T_{j,j}$ is the Jäschke Temperature on branch j , defined as

$$T_{j,j} = \sum_{i=1}^{M_j} a_{i,j}, \quad (17)$$

with the parameter $a_{i,j}$ defined recursively as

$$a_{i,j} = \frac{(\theta_{i,j} - \theta_{i-1,j})(\theta_{i,j} + \theta_{i-1,j} - a_{i-1,j})}{\theta_{hi,j} - \theta_{i-1,j}}, \quad a_{0,j} = 0. \quad (18)$$

In Appendix A we provide a proof of Theorem 2 for $M_j = 1$ and $M_j = 2$. Moreover, we prove the case $M_j = 3$ for heat exchangers with constant hot stream temperatures (this corresponds to very large hot stream heat capacities). For $M_j \geq 4$ we conjecture that the Theorem is true.

Theorem 2 implies that the optimal split that maximizes the total heat transfer can be obtained by simply controlling the Jäschke Temperatures in all branches to equal values. Note that the Jäschke Temperature on branch j only depends on the temperatures on this branch ($\theta_{i,j}$), and the hot inlet temperatures on this branch ($\theta_{hi,j}$). In Figs. 1 and 3 the temperatures required to calculate the Jäschke Temperatures are highlighted in boxes. In particular, we do not need to know the heat capacities or the flow rates of the streams ($F_0, F_j, F_{hi,j}$), nor do we require information about the heat transfer properties $UA_{i,j}$ to calculate the Jäschke Temperatures.

Example 1 (Maximize heat transfer, $M_1 = M_2 = 1$). For the network depicted in Fig. 1, the controlled variable is

$$c = T_{j,1} - T_{j,2} = \frac{\theta_{1,1}^2}{\theta_{h1,1}} - \frac{\theta_{1,2}^2}{\theta_{h1,2}}.$$

Adjusting the split between the branches such that $c = 0$ results in optimal operation when the arithmetic mean temperature difference assumption is satisfied. Moreover, keeping c at zero is optimal in spite of varying operating conditions, such as changing stream temperatures or changing heat transfer properties due to fouling in the heat exchangers.

We can extend Theorem 2 to the case where the hot sources have different prices $p_{i,j}$, and where the objective is to minimize the economic cost of operating the heat exchanger network.

Theorem 3. *Under Assumptions 1–3 and an economic objective (14) with arbitrary prices $p_{i,j}$, the marginal costs for each branch $j = 1 \dots N$ can be expressed as*

$$\frac{\partial J}{\partial w_j} = T_{j,j}^e \quad (19)$$

where the Economic Jäschke Temperature $T_{j,j}^e$ is defined as

$$T_{j,j}^e = \sum_{i=1}^{M_j} p_{i,j} a_{i,j} \quad (20)$$

with the parameter $a_{i,j}$ defined as in Theorem 2.

Strictly speaking, Theorem 2 is a special case of Theorem 3. It is obtained by setting all $p_{i,j}$ equal to 1. However, because of its practical importance, we chose to write Theorem 2 as a separate theorem.

In Appendix A we provide a proof of Theorem 3 for $M_j = 1$ and $M_j = 2$. There we also prove the case $M_j = 3$ for heat exchangers with constant hot stream temperatures (this corresponds to very large hot stream heat capacities). For $M_j \geq 4$ we conjecture that the Theorem is true.

Example 2 (Minimizing economic cost, $M_1 = 1, M_2 = 2$). For a system with 1 heat exchanger on the first line and 2 heat exchangers on the second line, and with prices $p_{1,1}$, $p_{1,2}$ and $p_{2,2}$ the controlled variable becomes

$$c = T_{j,1}^e - T_{j,2}^e = p_{1,1} \frac{\theta_{1,1}^2}{\theta_{h1,1}} - \left(p_{1,2} \frac{\theta_{1,2}^2}{\theta_{h1,2}} + p_{2,2} \frac{(\theta_{2,2} - \theta_{1,2}) \left(\theta_{2,2} + \theta_{1,2} - \frac{\theta_{1,2}^2}{\theta_{h1,2}} \right)}{\theta_{h2,2} - \theta_{1,2}} \right). \quad (21)$$

Note that when there is no heat exchange in the second heat exchanger of line 2, i.e. we have $\theta_{1,2} = \theta_{2,2}$, Eq. (21) reduces to the case where there is only one heat exchanger per line, and c becomes $c = p_{1,1} \frac{\theta_{1,1}^2}{\theta_{h1,1}} - p_{1,2} \frac{\theta_{1,2}^2}{\theta_{h1,2}}$. Similarly, when there is no heat exchange in the first heat exchanger on line 2 ($\theta_{1,2} = 0$), the expression simplifies to $c = p_{1,1} \frac{\theta_{1,1}^2}{\theta_{h1,1}} - p_{2,2} \frac{\theta_{2,2}^2}{\theta_{h2,2}}$.

5. Simulation case studies

In this section, we apply our approach to heat exchangers networks which are modelled using the logarithmic mean temperature difference as driving force for the heat transfer. Although the assumption of the arithmetic mean temperature difference is no longer satisfied, the simulations show that our approach yields good performance.

First we present two cases where the objective is simply to maximize the total heat transfer. Then we show an example where the operating cost is minimized when the hot stream prices differ. We compare the results obtained from controlling the Jäschke Temperatures with the true optimum, and we also present results for the case when the end temperatures are controlled to equal values (isothermal mixing).

Table 1
Data for Case Study 1.

Variable	Value	Unit	Description
T_0	60	°C	Cold feed temperature
w_0	100	kW/K	Cold feed heat capacity
$w_{h1,1}$	30	kW/K	Hot stream 11 heat capacity
$w_{h1,2}$	50	kW/K	Hot stream 12 heat capacity
$T_{h1,1}$	120	°C	Hot stream 11 temperature
$T_{h1,2}$	220	°C	Hot stream 12 temperature
$UA_{1,1}$	50	°C	HX 11 area \times heat transf. coeff.
$UA_{1,2}$	80	°C	HX 12 area \times heat transf. coeff.

Table 2
Results for Case Study 1.

	Optimized	Equal Jäschke Temp.	Isothermal mixing
End temp.	124.8917 °C	124.8045 °C	119.9388 °C
Split $u = \frac{F_1}{F_0}$	0.2704	0.2361	0.0600

5.1. Case Study 1: one heat exchanger per branch


We consider a simple case with one heat exchanger per line, where the streams are merged after being heated, Fig. 1. Instead of manipulating the flows directly, we select the split

$$u = \frac{F_1}{F_0} = \frac{w_1}{w_0}$$

as manipulated variable. We assume that the prices are equal on both lines, $p_{1,1} = p_{1,2}$, so the objective is to maximize the end temperature T_{end} . The stream parameters are given in Table 1.

Table 2 shows the end temperature T_{end} for the true optimum (maximally achievable end temperature), the end temperature from controlling the Jäschke Temperatures to equal values, and the end temperature obtained from isothermal mixing, which is obtained from controlling $T_{1,1} = T_{1,2}$. The Jäschke Temperature approach gives an end temperature which is very close to optimal, while isothermal mixing results in a loss of almost 5 °C.

Fig. 4 shows how well the arithmetic mean temperature approximates the logarithmic mean temperature in the exchangers. Further, we included the bounds where the approximation of the logarithmic mean temperature is less than 1%. At the optimum the approximation error of heat exchanger 2 is larger than 1%. This is the reason why the Jäschke Temperature approach deviates slightly

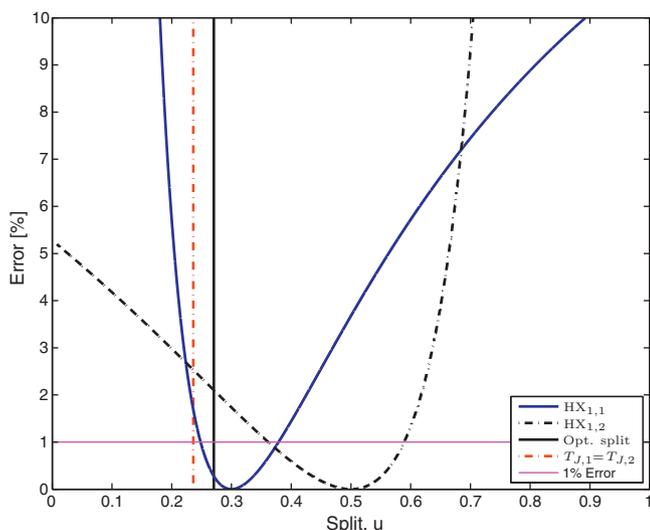**Fig. 4.** Case Study 1: Error between the logarithmic mean temperature difference in the heat exchangers and the arithmetic mean temperature as a function of the split $u = F_1/F_0$.**Table 3**
Data for Case Study 2.

Variable	Value	Unit	Description
T_0	60	°C	Feed temperature
w_0	100	kW/K	Feed heat capacity
$w_{h1,1}$	50	kW/K	Hot stream 11 heat capacity
$w_{h2,1}$	30	kW/K	Hot stream 21 heat capacity
$w_{h1,2}$	40	kW/K	Hot stream 12 heat capacity
$T_{h1,1}$	80	°C	Hot stream 11 inlet temperature
$T_{h2,1}$	140	°C	Hot stream 21 inlet temperature
$T_{h1,2}$	220	°C	Hot stream 12 inlet temperature
$UA_{1,1}$	80	kW/K	HX11 area \times heat transf. coeff.
$UA_{2,1}$	50	kW/K	HX21 area \times heat transf. coeff.
$UA_{1,2}$	65	kW/K	HX12 area \times heat transf. coeff.

from the optimal split. However, due to the flatness of the unconstrained optimum, our approach still gives a close to optimal T_{end} .

In Fig. 5 we plotted the split ratio against the final temperature T_{end} and included the difference between Jäschke Temperatures of the two lines, $c = \frac{\theta_{1,1}^2}{\theta_{h1,1}} - \frac{\theta_{1,2}^2}{\theta_{h1,2}}$. We see that there is only one point where $c=0$, i.e. $T_{j,1} = T_{j,2}$, and that c is a monotone function of the input u . The monotonicity around the optimal point $c=0$ is important as it ensures controllability.

5.2. Case Study 2: Two exchangers on first branch, one exchanger on second branch

Next, we give an example of a system with 2 heat exchangers in series on the first line, and one heat exchanger on the second line. Here too, the objective is to maximize the total heat transfer and to maximize T_{end} . The stream data are listed in Table 3, and the simulation results are summarized in Table 4, where the optimal end temperature is presented together with results that are obtained when using the our new approach and when implementing isothermal mixing. The difference between the optimal T_{end} and the T_{end} using the Jäschke Temperatures is very small, while the isothermal mixing strategy again results in a higher loss.

Fig. 6 shows the approximation errors in the three heat exchangers as a function of the split u . Here, too, we find that even though the approximation error is about 23% for the exchanger 11 and larger than 2% for the other heat exchangers, the Jäschke Temperature approach gives good results.

In Fig. 7 we plotted the cost function versus split ratio together with the controlled variable $c = T_{j,1} - T_{j,2}$. We observe that here too, the controlled variable is zero very close to the optimum, and crosses zero only once.

5.3. Case Study 3: One heat exchanger per branch – different prices

We consider the same heat exchanger network as in Case Study 1, but now with an economic objective involving different prices associated with heat transfer from the two heat exchangers. The stream temperatures and flow data are the same as before, given in Table 1. The economic cost is then

$$J = (p_{1,1}^{cost} - p_{1,1}^{rev})Q_{1,1} + (p_{1,2}^{cost} - p_{1,2}^{rev})Q_{1,2}. \quad (22)$$

Table 4
Results for Case Study 2

	Optimized	Equal Jäschke Temp.	Isothermal mixing
End Temp.	122.7726 °C	122.7549 °C	120.8782 °C
Split $u = \frac{F_1}{F_0}$	0.4326	0.4147	0.2559

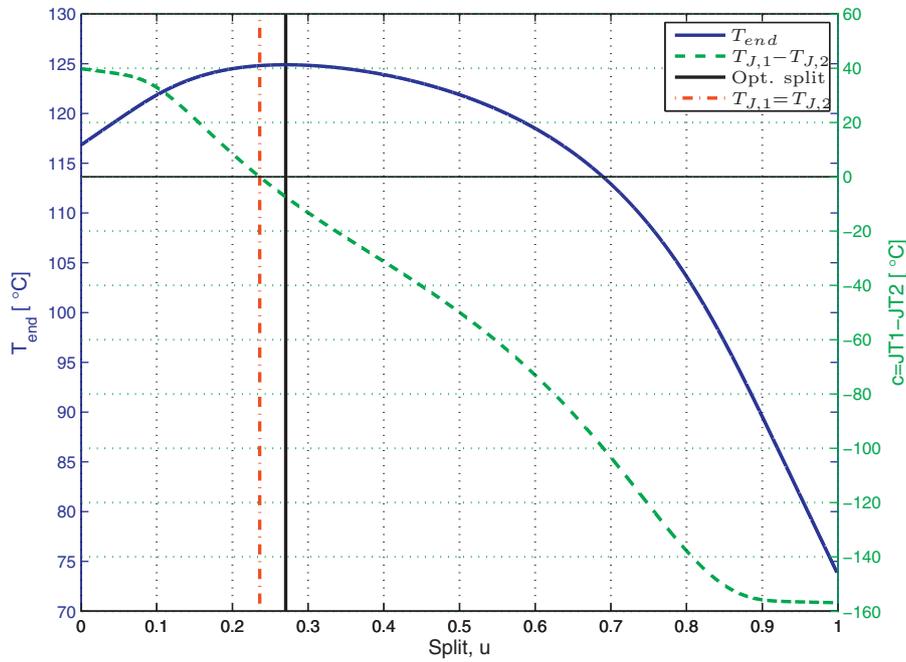


Fig. 5. Case Study 1: End temperature and controlled variable $c = T_{J,1} - T_{J,2}$.

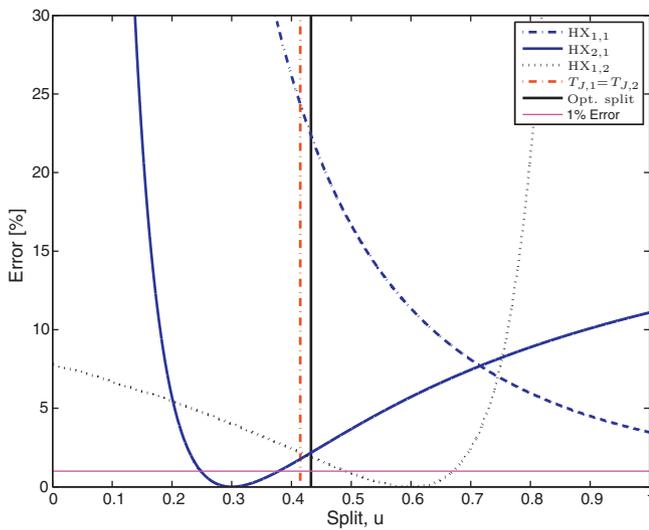


Fig. 6. Case Study 2: Error between the logarithmic mean temperature difference in the heat exchangers and the arithmetic mean temperature as a function of the split $u = \frac{F_1}{F_0}$.

Assuming that $p_{1,1}^{rev} = p_{1,2}^{rev} = 0.3 \text{ ¢/kJ}$, and $p_{1,1}^{cost} = 0.1 \text{ ¢/kJ}$, and $p_{1,2}^{cost} = 0.2 \text{ ¢/kJ}$, the simplified cost (14) becomes

$$J = -0.2 \frac{\text{¢}}{\text{kJ}} Q_{1,1} - 0.1 \frac{\text{¢}}{\text{kJ}} Q_{1,2}, \quad (23)$$

and this cost function encourages to prefer using heat exchanger 11 to heat exchanger 12. This will not result in the maximally possible end temperature, but it will optimize the process economics. Table 5 lists the optimal operating cost together with the cost from our approach and the isothermal mixing approach.

The optimal cost, and the cost found by our approach are very close. As expected isothermal mixing gives the highest cost. This is further illustrated in Fig. 8, where the profit and the controlled variables are shown for all possible splits u . As above, the controlled variable is zero only once, and very close to the optimal split.

Table 5
 Results for Case Study 3.

	Optimized	Equal Jäschke Temp	Isothermal mixing
Operating cost (\$/s)	-7.6256	-7.6250	-6.3536
Split $u = \frac{F_1}{F_0}$	0.3452	0.3364	0.0600

6. Discussion

6.1. Relation to other work

An interesting interpretation of the Jäschke Temperatures can be given in terms of the heat exchanger efficiency as used in the NTU method (Mills, 1995). Consider the case of a network with one heat exchanger per branch, as in Fig. 1. Using the heat exchanger efficiency on the cold side ε_c , the cold outlet temperature on branch j can be calculated by

$$T_{1,j} = \varepsilon_c T_{h1,j} + (1 - \varepsilon_c) T_0, \quad (24)$$

and solving for ε_c yields

$$\varepsilon_c = \frac{T_{1,j} - T_0}{T_{h1,j} - T_0}. \quad (25)$$

On the other hand, the Jäschke Temperature for this branch can be expressed using ε_c as

$$T_{J,j} = \frac{(T_{1,j} - T_0)^2}{T_{h1,j} - T_0} = \varepsilon_c (T_{1,j} - T_0). \quad (26)$$

This gives rise to a nice interpretation of our work: The Jäschke Temperatures for this case may be considered “corrected” or “weighted” efficiencies, where the NTU-efficiency is weighted by the actual temperature rise $T_{1,j} - T_0$, and optimal operation is achieved when all branches are operated with the same weighted efficiency.

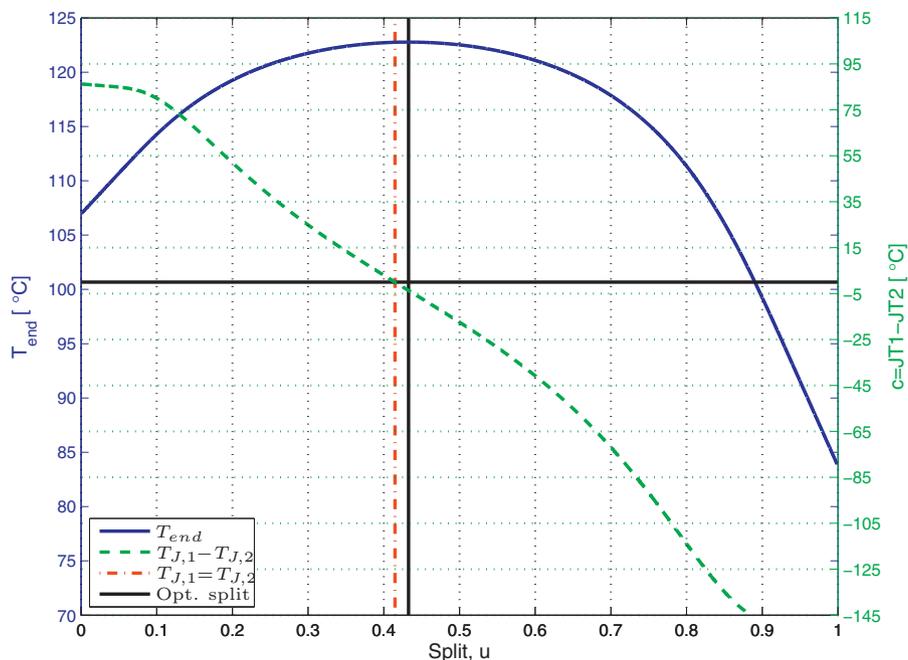


Fig. 7. Case Study 2: End temperature and controlled variable $c = T_{J,1} - T_{J,2}$.

In case of more than one heat exchanger per line the Jäschke Temperatures are calculated according to (17) and (18). Defining the efficiency of heat exchanger i on line j as

$$\varepsilon_{ci,j} = \frac{\theta_{i,j} - \theta_{i-1,j}}{\theta_{hi,j} - \theta_{i-1,j}}, \quad (27)$$

and the weighting as

$$(\theta_{i,j} + \theta_{i-1,j} - a_{i-1,j}), \quad (28)$$

the components of the Jäschke Temperature can then be written as

$$a_{i,j} = \varepsilon_{ci,j}(\theta_{i,j} + \theta_{i-1,j} - a_{i-1,j}). \quad (29)$$

Thus, the Jäschke Temperature of a line may be considered as the weighted sum of the efficiencies of the heat exchangers on that line.

6.2. Flow configurations and network topologies

6.2.1. Heat exchanger flow configuration

The assumption of the arithmetic mean temperature difference does not imply anything on the flow configuration within the heat exchangers. However, the assumption will generally be better satisfied in heat exchangers with counter-current flows than in co-current flow heat exchangers, because the temperature profiles in the hot and the cold medium are closer to parallel.

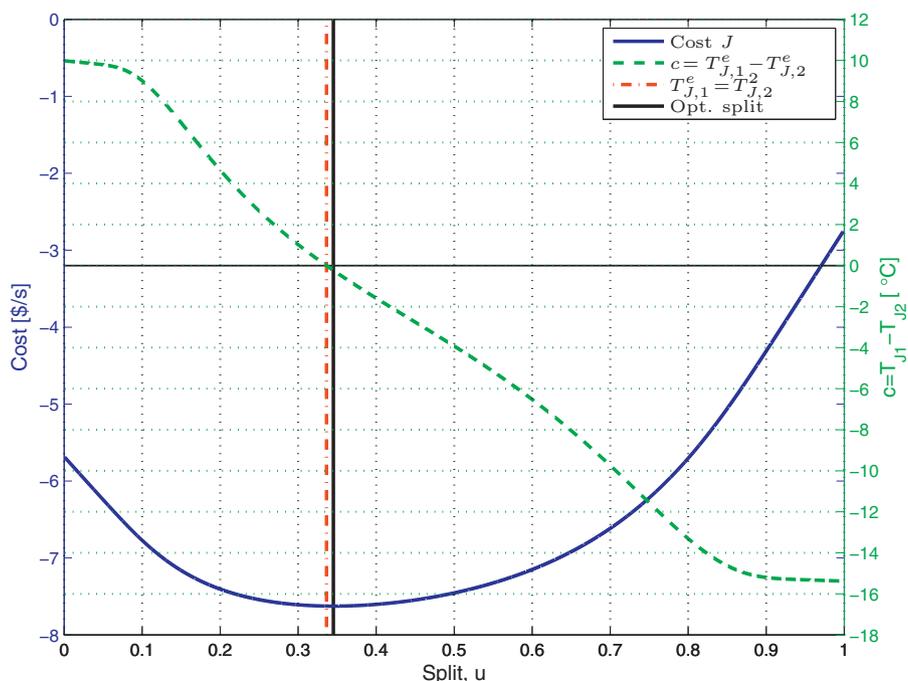


Fig. 8. Case Study 3: Economic cost and controlled variable $c = T_{J,1}^e - T_{J,2}^e$ for different values of the split ratio.

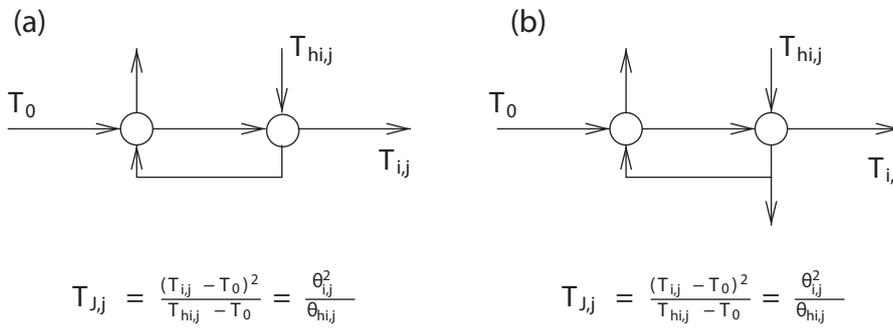


Fig. 9. Alternative topologies with corresponding Jäschke Temperature.

6.2.2. Alternative network topologies

Although the results in this paper were derived for a standard heat exchanger configuration, as shown in Fig. 1 and 3, the results are more widely applicable than it may seem at first sight, because they can be applied to related, equivalent topologies. In our approach, the heat capacities w , the heat transfer properties UA , and the outlet temperatures of the hot streams can be considered as disturbances, which have been eliminated from the optimality conditions. It is therefore possible to use our controlled variables for systems, which can be modeled as standard systems, by adjusting the heat transfer area and/or the heat capacities. For example, the system in Fig. 9a may be modeled as a single counter-current heat exchanger, and the Jäschke Temperature can be calculated accordingly. Similarly, when more than two heat exchangers on a branch are connected to a single hot stream, they may be modeled as a single heat exchanger.

Also, the configuration in Fig. 9b can be modeled as a single heat exchanger, because the effect of the reduced flow in the second heat exchanger on the hot path is equivalent to the effect of a reduced overall heat transfer coefficient. Of course, it is possible to combine all the above configurations, such that beside the examples given above, all parallel flow configurations which can be modeled as one or more heat exchangers on a line, may be operated close to optimal by our approach.

Another interesting special case is the case where an exchanger is split into two, such that both, the hot and the cold stream are split, see Fig. 10.

Here the hot stream temperatures are identical, so requiring equal Jäschke Temperatures for the cold split $\frac{\theta_1^2}{\theta_{h0}} = \frac{\theta_2^2}{\theta_{h0}}$ is equivalent to requiring $T_1 = T_2$. Similarly, for the hot stream split, requiring

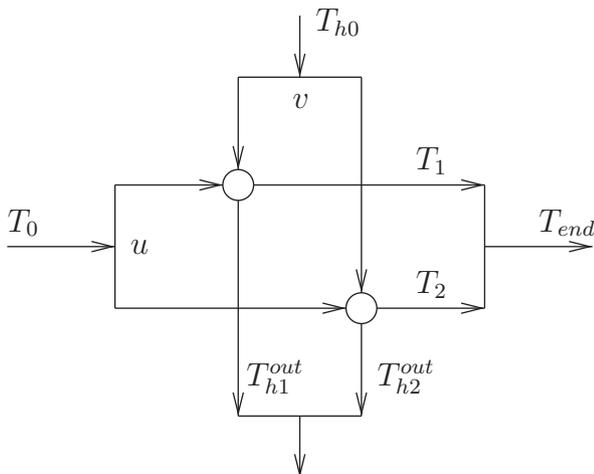


Fig. 10. Configuration where the hot and the cold stream are split, the degrees of freedom are the split fractions u and v .

equal Jäschke Temperatures $\frac{(T_{h1}^{out} - T_{h0})^2}{T_0 - T_{h0}} = \frac{(T_{h2}^{out} - T_{h0})^2}{T_0 - T_{h0}}$ is equivalent to $T_{h1}^{out} = T_{h2}^{out}$. This is indeed the optimal solution.

Our controlled variable may also be used when the flow through one or more branches is not available as a degree of freedom. An example for this case is given in Fig. 11, where there is a temperature constraint on the hot outflow of the first branch. In this case, the fraction through the first branch u_1 is not available as a degree of freedom for optimization, as it must be used to maintain the exit temperature of the hot stream. However, the second degree of freedom u_2 can be used control the difference between the Jäschke Temperatures in the second and third branch. This maximizes the heat transfer in the exchangers on these branches (and T_{end}).

6.3. Phase change in heat exchangers

A heat exchanger with condensing steam on the hot side (constant hot side temperature) may be modeled as a single phase heat exchanger with a very large hot heat capacity ($w_{hi,j} \rightarrow \infty$). As long as the arithmetic mean temperature driving force assumption is satisfied, controlling the Jäschke Temperatures of all branches to equal values results in optimal operation, regardless of the heat capacities in the hot and cold streams. Therefore one may also use the Jäschke Temperature approach for controlling heat exchanger networks with condensing steam as a heat source. However, in these cases the arithmetic mean temperature difference assumption may be violated severely in real heat exchangers, which may or may not impact the performance (in Fig. 6 we see that a large approximation error does not necessarily imply poor performance).

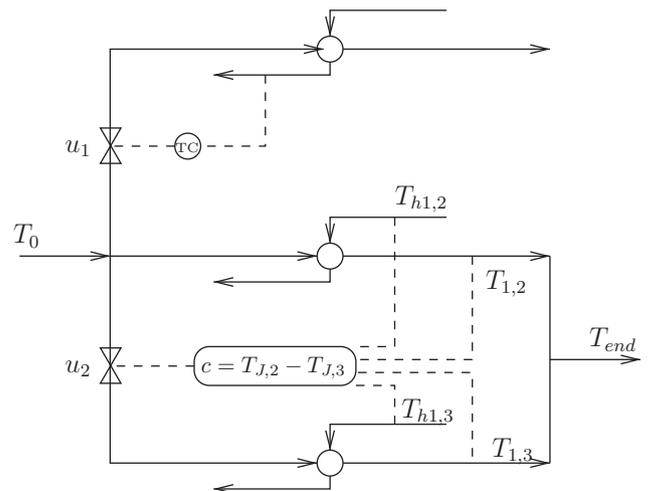


Fig. 11. Control structure where one degree of freedom is used to control another variable.

6.4. General elimination

At first sight it may be surprising that it is possible to obtain controlled variables, which do not contain any heat capacities or heat transfer properties. Alstad and Skogestad (2007) stated that this requires that the number of independent measurements is greater or equal to the sum of the number of degrees of freedom and the disturbances, $n_y \geq n_u + n_d$. However, this requirement may be conservative sometimes, as we show in the simple following toy example. Consider the cost

$$\min J = \frac{1}{2}(u - d)^2,$$

where u is the degree of freedom and d is an unmeasured disturbance parameter. The optimal controlled variable is the gradient,

$$c = J_u = (u - d), \quad (30)$$

and the minimum number of measurements is $n_u = 1$. To need only a single measurement, we must measure the gradient itself, $y = J_u = (u - d)$, or some locally monotone scalar valued function of it.² However, if the gradient is not measured directly, we need two independent measurements, one for eliminating u , and one for eliminating d from the gradient expression (30).

Now consider another toy example, where the cost function is

$$\tilde{J} = \frac{1}{2}(u - 1)^2 + d^2. \quad (31)$$

Here, the gradient $\tilde{J}_u = u - 1$ contains only one variable, and only one measurement is required. That is, we can measure u and set $u = 1$.

If however, new variables (disturbances) are present in the measurement equations, then additional measurements are required. Consider again (31). If the only measurement is $y_1 = G_1 u + G_{1d} d$, then it cannot be used to eliminate u , because a new variable d is introduced. In this case, a second measurement $y_2 = G_2 u + G_{2d} d$ necessary to eliminate d from the measurement equation for y_1 , such that $d = 1/G_{2d}(y_2 - G_2 u)$. Inserting into the first measurement equation gives $y_1 = G_1 u + G_{1d}/G_{2d}(y_2 - G_2 u)$. Thus, the optimal controlled variable $\tilde{J}_u = u - 1$ can be expressed using the measurements as $c = \tilde{J}_u = u - 1 = (y_1 - G_{1d}/G_{2d}y_2)/(G_1 - G_{1d}/G_{2d}G_2) - 1$.

The minimum number of measurements depends thus on the process structure, and for finding a controlled variable which is equivalent to controlling the gradient, the minimum number of measurements required is n_u (when the gradient is measured) and at most $n_u + n_d$.

6.5. Strengths and limits of our approach

The big advantage of our method is that it is very simple, and still gives close to optimal performance. Neither flow rates nor heat capacities need to be measured. The main underlying assumptions in the derivation of the Jäschke Temperatures are the arithmetic mean temperature difference as driving force for the heat transfer, and constant specific heat capacity.

Even when the arithmetic mean temperature difference assumption is violated, we have shown that our controlled variables give good performance. However, for very poorly designed heat exchanger networks, which are operated with very unequal heat capacities on the hot and the cold side, the performance can deteriorate. For very extreme cases, that is when one of the hot streams has a much higher heat capacity than the cold feed stream, and a much lower temperature than the other hot streams, the approximation by the arithmetic temperature difference may

become very poor, and it may not be possible to control the differences between the Jäschke Temperatures to zero. However, when such a case is implemented using PI controllers with anti-windup, the controller will attempt to control the difference to zero, and this will result in fully opening the dominating branch and closing others. This will not be optimal, but the loss will be relatively small, because most of the heat is transferred in the dominating branch, and the other branches contribute only little to the total transferred heat. If truly optimal performance is required for such extreme cases, a different approach has to be chosen, which essentially is based on a more accurate model. Such a method will typically require more effort in implementing and maintaining.

In well designed real heat exchanger networks, however, the hot and the cold heat capacities will be similar, and this will make the approximation error of the arithmetic mean temperature difference small. Another factor which mitigates the effect of the approximation error is that the objective function in such systems tends to be very flat near the optimum, such that a split which is only close to optimal will give a good performance. This flat nature of the optimum will generally also give near-optimal operation when the heat capacities are temperature dependent.

One of the limitations of this method is that it requires the marginal costs to be decoupled, i.e. it is not possible to have crossovers between the lines. If there are crossovers, it is not possible to find optimality conditions of the form $c = c_1 - c_2$, where c_j contains only variables from branch j , and we must use other approaches, such as described in e.g. Alstad et al. (2009).

6.6. Practical implementation issues

6.6.1. Handling singularities

The formulas for the Jäschke Temperatures derived in this paper contain temperature differences in the denominators, $\theta_{hi,j} - \theta_{i-1,j}$ which under practical operation may cross zero and become negative. When this temperature difference becomes negative, the cold stream is cooled down (rather than heated) in the particular heat exchanger. This results in a negative contribution to the Jäschke Temperature.

When the temperatures of the hot inlet stream and the cold inlet stream of a heat exchanger are equal, $\theta_{hi,j} = \theta_{i-1,j}$, there is no heat transfer in that particular heat exchanger. Operation at such this point is unlikely in practice, as this is a zero-measure set. However during transients this may well happen, and then the Jäschke Temperatures become singular, which can result in unpredictable controller behavior.

To avoid this undesirable behavior, there are two possible approaches. The first one is to implement the controlled variable denominator-free by multiplying the controlled variable with the greatest common denominator. For a system with one heat exchanger per line, as in Example 1, the controlled variable becomes

$$c = \theta_{1,1}^2 \theta_{h1,2} - \theta_{1,2}^2 \theta_{h1,1}.$$

In this case the controlled variable never becomes singular. Topologies with more than one heat exchanger on a line can be treated similarly.

An alternative approach is to use a piecewise defined Jäschke Temperatures to patch the singular point. Here, we define the variable $a_{i,j}$ in (18) as

$$a_{i,j} = \begin{cases} \frac{(\theta_{i,j} - \theta_{i-1,j})[\theta_{i,j} + \theta_{i-1,j} - a_{i-1,j}]}{\theta_{hi,j} - \theta_{i-1,j}} & \text{for } |\theta_{hi,j} - \theta_{i-1,j}| > \epsilon \\ 0 & \text{for } |\theta_{hi,j} - \theta_{i-1,j}| \leq \epsilon \end{cases}$$

where ϵ is a small tunable parameter, e.g. $\epsilon = 10^{-3}$.

² The monotonicity around its optimal value is necessary for controllability.

6.6.2. Controlling the Jäschke Temperatures

In Section 2 we have shown that a system with N parallel lines has $N - 1$ degrees of freedom. To fully specify the system, we need to control $N - 1$ controlled variables such that all the Jäschke Temperatures are equal. The simplest way to achieve this is to select the controlled variables as

$$\begin{aligned} c_1 &= J_{T,1} - J_{T,N} \\ c_2 &= J_{T,2} - J_{T,N} \\ &\vdots \\ c_{N-1} &= J_{T,N-1} - J_{T,N} \end{aligned} \quad (32)$$

We recommend to number the streams $j = 1, \dots, N$ such that stream N has the largest heat capacity, because the Jäschke Temperature of the largest stream will not vary very much compared to the Jäschke Temperatures of the other streams. Alternatively, one could use the mean Jäschke Temperature over all branches as a reference and control the variables

$$c_j = J_{T,j} - \frac{1}{N} \sum_{k=1}^N J_{T,k}. \quad (33)$$

The controlled variables may either be controlled by decentralized controllers such as PID controllers, or by centralized controllers such as model predictive controllers. In both cases, the controller may act directly on valves or pumps, or give setpoint values to flow controllers in the branches.

When controlling differences between Jäschke Temperatures, it is important to note that disturbances in the incoming temperatures T_0 and T_{hj} have an immediate effect on the controlled variables and can lead to an undesirable response. This may be mitigated by filtering the incoming temperatures such that all responses are on a similar time-scale.

Of the N degrees of freedom in such a parallel system, only $N - 1$ are independent. The N th degree of freedom cannot be used to optimize the split. However, it can be used to minimize the pressure drop over the system (Leruth, 2012).

7. Conclusions and future work

We have presented an approach for optimizing the split between the lines of a parallel heat exchanger system. Although the Jäschke Temperatures are developed for the arithmetic temperature difference, they give good results for the realistic case with logarithmic temperature difference. In particular, our approach gives good performance for well-designed heat exchangers, where the heat capacities on the hot and the cold side are approximately the same.

For the case with 1–3 heat exchangers per line, we have proven under the assumption of the arithmetic mean temperature difference as driving force for the heat transfer, that the Jäschke Temperatures are equal to the marginal costs. The more general case with more than 3 heat exchangers is conjectured.

We would like to mention again that the Jäschke Temperatures can be used also in the case where the hot stream is split into parallel streams, which are cooled down.

Controlling the Jäschke Temperatures for optimizing the split has an additional practical advantage. If one of the flows F_i is set to manual (or is used to control some thing else) the rest of the control structure remains unaffected.

A limitation is that we cannot handle systems with crossovers, because the optimality conditions are no longer decoupled. Future work will consider possibilities to handle coupled optimality conditions, and to integrate our approach into a larger setting, where not only the heat transferred in the heat exchangers is maximized,

but rather the economics of the whole plant. Another direction for future work is to investigate possible connections to established methods for heat exchanger network design, such as pinch analysis.

Acknowledgements

The authors would like to thank the anonymous reviewer for pointing out the connection to the efficiencies, and gratefully acknowledge contributions in the Master's thesis of Daniel G. Edvardsen and Stian Aaltvedt, and the funding of this work by the Norwegian Research Council.

Appendix A. Proofs and derivations

In this section we show how we obtained the results presented this paper. The procedure is based on Jäschke and Skogestad (2012b), where we use a model to formulate the optimality conditions, and then use the model to eliminate unmeasured variables from the optimality conditions. We present only the proof for the economic case (Theorem 3), because the case of maximizing heat transfer (Theorem 2) is obtained as a special case by setting $p_{ij} = 1$ for all i, j .

For Theorem 3, we present in this section:

- an analytical proof derived in equations for $M_j = 1$,
- an algebraic proof using maple for $M_j = 2$,
- an algebraic proof using maple, and in addition assuming infinite heat capacity on the hot side (corresponds to condensing steam on the hot side) for $M_j = 3$.

The case $M_j > 3$ is conjectured.

A.1. Analytical proof of Theorem 3 for $M_j = 1$

An example of this case is shown in Fig. 1. In this section, for simplicity of notation, since every line contains only one heat exchanger, we omit the index i denoting the heat exchanger, such that e.g. T_{i2} is denoted T_2 . Expressed in shifted temperatures θ , the energy balance (9) and (10) around the heat exchanger on line j becomes

$$Q_j = w_j \theta_j \quad (A.1)$$

$$Q_j = w_{hj} (\theta_{hj} - \theta_{hj}^{out}) \quad (A.2)$$

Combining (A.1) and (A.2), and solving for θ_{hj}^{out} yields

$$\theta_{hj}^{out} = \frac{w_{hj} \theta_{hj} - w_j \theta_j}{w_{hj}}. \quad (A.3)$$

Under Assumption 3 (arithmetic mean temperature difference), the transferred heat is

$$Q_j = \frac{UA_j}{2} (\theta_{hj} - \theta_j + \theta_{hj}^{out}). \quad (A.4)$$

Equating with (A.1) we have

$$\frac{UA_j}{2} (\theta_{hj} - \theta_j + \theta_{hj}^{out}) = w_j \theta_j,$$

and inserting (A.3) yields

$$\frac{UA_j}{2} \left(\theta_{hj} - \theta_j + \frac{w_{hj} \theta_{hj} - w_j \theta_j}{w_{hj}} \right) = w_j \theta_j.$$

Upon solving for θ_j , we obtain

$$\theta_j = \frac{\theta_{hj}}{1 - w_j(1/w_{hj} + 2/UA_j)}. \quad (A.5)$$

This expression for θ_i can be used in the objective function. For a system with N lines, we have

$$J = \sum_{j=1}^N J_j = - \sum_{j=1}^N p_j Q_j = - \sum_{j=1}^N p_j w_j \theta_j.$$

And the corresponding marginal cost for each branch is

$$\begin{aligned} \frac{\partial J}{\partial w_j} &= p_j \frac{\partial Q_j}{\partial w_j} = p_j \frac{\partial}{\partial w_j} w_j \theta_j = p_j \frac{\partial}{\partial w_j} \left(\frac{w_j \theta_{hj}}{1 - w_j (1/w_{hj} + 2/UA_j)} \right) \\ &= p_j \frac{\theta_{hj}(1 - w_j(1/w_{hj} + 2/UA_j)) + w_j \theta_{hj}(1/w_{hj} + 2/UA_j)}{(1 - w_j(1/w_{hj} + 2/UA_j))^2} \\ &= p_j \frac{\theta_{hj}}{(1 - w_j(1/w_{hj} + 2/UA_j))^2}. \end{aligned} \quad (\text{A.6})$$

By noting that (A.5) implies

$$\frac{\theta_j}{\theta_{hj}} = \frac{1}{1 - w_j(1/w_{hj} + 2/UA_j)}$$

we can write (A.6) as

$$\frac{\partial J_j}{\partial w_j} = p_j \frac{\theta_j^2}{\theta_{hj}}, \quad (\text{A.7})$$

which completes the proof for $M_j = 1$. \square

The Jäschke Temperatures for the case $M_j = 1$ were originally found using the approach described in Jäschke and Skogestad (2012b), where a computer algebra program is used to perform the elimination. This computer algebra approach is also used to prove the case $M_j = 2$ and $M_j = 3$ in the next section. The analytical proof presented above was only found afterwards, after the structure of the Jäschke Temperatures was known.

Note that the arithmetic mean temperature difference assumption made it possible to eliminate the heat capacity w_j and the heat

$$\begin{aligned} c &= \left(\frac{-\theta_{1,1}^2 \theta_{2,1} \theta_{h2,1} + \theta_{1,1}^3 \theta_{2,1} + \theta_{1,1}^2 \theta_{h2,1} \theta_{h3,1} - \theta_{1,1}^3 \theta_{h3,1}}{\theta_{h1,1}(-\theta_{2,1} \theta_{h2,1} + \theta_{h2,1} \theta_{h3,1} + \theta_{1,1} \theta_{2,1} - \theta_{1,1} \theta_{h3,1})} \right) p_{1,1} \\ &+ \left(\frac{\theta_{1,1}^2 \theta_{2,1} \theta_{h1,1} + \theta_{1,1}^2 \theta_{2,1}^2 - \theta_{1,1}^3 \theta_{2,1} - \theta_{1,1}^2 \theta_{2,1} \theta_{h3,1} + \theta_{1,1}^3 \theta_{h3,1} - \theta_{1,1}^2 \theta_{h1,1} \theta_{h3,1} - \theta_{2,1}^3 \theta_{h1,1} + \theta_{2,1}^2 \theta_{h1,1} \theta_{h3,1}}{\theta_{h1,1}(-\theta_{2,1} \theta_{h2,1} + \theta_{h2,1} \theta_{h3,1} + \theta_{1,1} \theta_{2,1} - \theta_{1,1} \theta_{h3,1})} \right) p_{2,1} \\ &- \left(\frac{\theta_{1,2}^2}{\theta_{h1,2}} \right) p_{1,2}. \end{aligned} \quad (\text{A.8})$$

transfer properties UA_j in such a simple manner.

A.2. Proof of Theorem 3 for $M_j = 2$

The situation becomes more complicated when there are more than one heat exchangers on a line, because the marginal cost contains variables from all heat exchangers on this line, and represents the accumulated effect of a change in the flow rate. For proving Theorem 3 for $M_j > 1$, we applied the method described in Jäschke and Skogestad (2012b), which is based on three main steps:

1. Model the system and formulate the optimality conditions.
2. Calculate the reduced gradient J_u .
3. Symbolically eliminate unmeasured parameters and states from the reduced gradient J_u using the sparse resultant (Cox et al., 2005).

We consider a heat exchanger network with 2 branches $j = 1, 2$ (Fig. A.12), which was modelled in Step 1. Here $M_1 = 2$ and $M_2 = 1$. The fact that $M_2 = 1$ implies no limitation on the generality of the

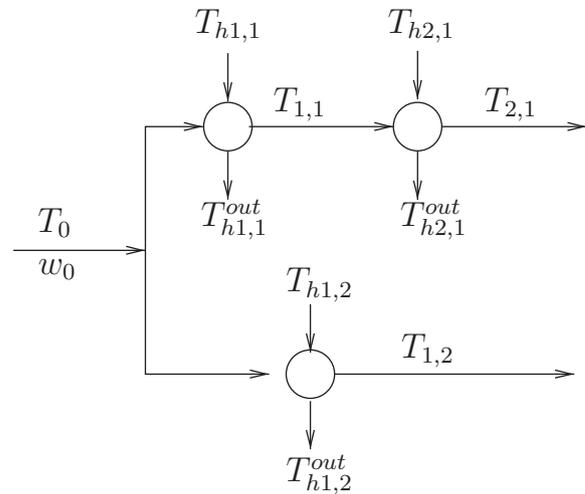


Fig. A.12. Heat exchanger network with two heat exchangers on the first line and one exchanger on the second line.

proof, since the marginal costs for each line are independent of each other, see Theorem 1.

The cost function for this case is

$$J = -(p_{1,1} Q_{1,1} + p_{2,1} Q_{2,1} + p_{1,2} Q_{1,2}),$$

and the reduced gradient in Step 2 was calculated in Maple (TM).³ It contains the temperatures, flow rates and heat transfer variables from all heat exchangers. Finally the elimination of UA_{ij} and the heat capacities $w_j, w_{hi,j}$ from the reduced gradient in Step 3 was performed using the Maple package `multires` (Busé and Mourrain, 2003).

The procedure above leads to a large algebraic expression c , which is zero whenever the gradient is zero ($c=0 \Leftrightarrow J_u=0$). Collecting the coefficients of the prices $p_{1,1}$, $p_{2,1}$, and $p_{1,2}$ leads to

Already now we see Economic Jäschke Temperature for the second branch with only one heat exchanger, $T_{j,2}^e = p_{1,2} \frac{\theta_{1,2}^2}{\theta_{h1,2}}$ in the last line. The two terms corresponding to $p_{1,1}$ and $p_{2,1}$ correspond to the Economic Jäschke Temperature of the first line. The coefficient of $p_{1,1}$ can be written as

$$\begin{aligned} a_{1,1} &= \frac{-\theta_{1,1}^2 \theta_{2,1} \theta_{h2,1} + \theta_{1,1}^3 \theta_{2,1} + \theta_{1,1}^2 \theta_{h2,1} \theta_{h3,1} - \theta_{1,1}^3 \theta_{h3,1}}{\theta_{h1,1}(-\theta_{2,1} \theta_{h2,1} + \theta_{h2,1} \theta_{h3,1} + \theta_{1,1} \theta_{2,1} - \theta_{1,1} \theta_{h3,1})} \\ &= \frac{\theta_{1,1}^2 (\theta_{h2,1} - \theta_{1,1})(\theta_{h3,1} - \theta_{2,1})}{\theta_{h1,1}(\theta_{h2,1} - \theta_{1,1})(\theta_{h3,1} - \theta_{2,1})} \\ &= \frac{\theta_{1,1}^2}{\theta_{h1,1}}, \end{aligned} \quad (\text{A.9})$$

and the coefficient of $p_{2,1}$ can be written as

³ Maple is a trademark of Waterloo Maple Inc.

$$\begin{aligned}
 a_{2,1} &= \frac{\theta_{1,1}^2 \theta_{2,1} \theta_{h1,1} + \theta_{1,1}^2 \theta_{2,1}^2 - \theta_{1,1}^3 \theta_{2,1} - \theta_{1,1}^2 \theta_{2,1} \theta_{h3,1} + \theta_{1,1}^3 \theta_{h3,1} - \theta_{1,1}^2 \theta_{h1,1} \theta_{h3,1} - \theta_{2,1}^3 \theta_{h1,1} + \theta_{2,1}^2 \theta_{h1,1} \theta_{h3,1}}{\theta_{h1,1}(\theta_{h2,1} - \theta_{1,1})(\theta_{h3,1} - \theta_{2,1})} \\
 &= \frac{(\theta_{h3,1} - \theta_{2,1})[\theta_{h1,1}(\theta_{2,1}^2 - \theta_{1,1}^2) - \theta_{1,1}^2(\theta_{2,1} - \theta_{1,1})]}{\theta_{h1,1}(\theta_{h2,1} - \theta_{1,1})(\theta_{h3,1} - \theta_{2,1})} = \frac{\theta_{2,1}^2 - \theta_{1,1}^2 - \frac{\theta_{1,1}^2}{\theta_{h1,1}}(\theta_{2,1} - \theta_{1,1})}{\theta_{h2,1} - \theta_{1,1}} \\
 &= \frac{(\theta_{2,1} - \theta_{1,1})(\theta_{2,1} + \theta_{1,1} - \frac{\theta_{1,1}^2}{\theta_{h1,1}})}{\theta_{h2,1} - \theta_{1,1}} \\
 &= \frac{(\theta_{2,1} - \theta_{1,1})(\theta_{2,1} + \theta_{1,1} - a_{1,1})}{\theta_{h2,1} - \theta_{1,1}}. \tag{A.10}
 \end{aligned}$$

Thus, the Economic Jäschke Temperature for a line j with $M_j = 2$ heat exchangers becomes

$$T_{j,j}^e = p_{1,j} \frac{\theta_{1,j}^2}{\theta_{h1,j}} + p_{2,j} \frac{(\theta_{2,j} - \theta_{1,j})(\theta_{2,j} + \theta_{1,j} - \frac{\theta_{1,j}^2}{\theta_{h1,j}})}{\theta_{h2,j} - \theta_{1,j}}. \tag{A.11}$$

This is exactly the structure proposed in Theorem 2 and 3, which completes the proof for $M_j = 2$. □

A.3. Proof of Theorem 3 for $M_j = 3$

To derive the Economic Jäschke Temperature for $M_j = 3$, we consider the system shown in Fig. A.13, where the objective is to minimize the cost

$$J = -(p_{1,1}Q_{1,1} + p_{2,1}Q_{2,1} + p_{3,1}Q_{3,1} + p_{1,2}Q_{1,2}).$$

The symbolic elimination using the sparse resultant is computationally very expensive, and for this case with $M_1 = 3, M_2 = 1$, it was not possible to perform the symbolic elimination using Maple and *multires* due to memory limitations.

However, since controlling the Jäschke Temperatures to equal values gives optimal operation independent of the magnitude of the heat capacity, we may hypothetically let the hot heat capacity go to infinity (or to a very large value). This will cause the hot inlet temperature and the hot outlet temperature to be equal, $\theta_{hi,j} = \theta_{hi,j}^{out}$, while the form of the Jäschke Temperatures are not affected.⁴

Therefore, to reduce the number of variables in the symbolic elimination, the case with $M_1 = 3$ was modelled with constant hot stream temperatures (this corresponds to a very large (infinite) heat capacity of the hot streams, or condensing steam), and the same procedure as in the previous section was applied.⁵

Now it is possible to obtain perform the symbolic elimination results for the case with $M_j = 3$, which leads to a large algebraic expression c , which is zero whenever the gradient is zero ($c = 0 \Leftrightarrow J_u = 0$). Collecting the coefficients of the prices $p_{1,1}$ and $p_{2,1}$ gives the same expressions as given in Eqs. (A.9) and (A.10) in Appendix A.2. The coefficient of the price $p_{3,1}$ is

$$\begin{aligned}
 a_{3,1} &= \frac{-\theta_{1,1}^2 \theta_{2,1} \theta_{h1,1} + \theta_{1,1}^2 \theta_{2,1} \theta_{h2,1} + \theta_{1,1}^2 \theta_{3,1} \theta_{h1,1} - \theta_{1,1}^2 \theta_{3,1} \theta_{h2,1} - \theta_{1,1}^2 \theta_{2,1}^2 + \theta_{2,1}^2 \theta_{h1,1} \theta_{h2,1} + \theta_{1,1} \theta_{2,1}^2 \theta_{h1,1} - \theta_{2,1}^2 \theta_{h1,1} \theta_{h2,1} - \theta_{1,1} \theta_{2,1}^2 \theta_{h1,1} + \theta_{2,1}^2 \theta_{2,1} \theta_{3,1} - \theta_{2,1}^2 \theta_{3,1} \theta_{h1,1} + \theta_{2,1}^3 \theta_{h1,1}}{\theta_{h1,1}(-\theta_{2,1} \theta_{h2,1} + \theta_{h2,1} \theta_{h3,1} + \theta_{1,1} \theta_{2,1} - \theta_{1,1} \theta_{h3,1})} \\
 &= \frac{(\theta_{3,1} - \theta_{2,1})(\theta_{3,1} + \theta_{2,1} - [(\theta_{2,1} - \theta_{1,1})(\theta_{2,1} + \theta_{1,1} - \frac{\theta_{1,1}^2}{\theta_{h1,1}})]/(\theta_{h2,1} - \theta_{1,1}))}{[\theta_{h3,1} - \theta_{2,1}]} \\
 &= \frac{(\theta_{3,1} - \theta_{2,1})(\theta_{3,1} + \theta_{2,1} - a_{2,1})}{\theta_{h3,1} - \theta_{2,1}}. \tag{A.12}
 \end{aligned}$$

⁴ This can also be seen in the derivation of the Jäschke Temperatures for the case of one heat exchanger per line in A.1 by setting $T_{hi,j} = T_{hi,j}^{out}$ and letting $w_{hj} \rightarrow \infty$.

⁵ The decision to assume a constant hot stream temperature and $w_{hi,j} \rightarrow \infty$ means that the variables $T_{h1,1}^{out}, T_{h2,1}^{out}, T_{h3,1}^{out}, T_{h1,2}^{out}, w_{h1,1}, w_{h2,1}, w_{h3,1}, w_{h1,2}$ do not need to be eliminated.

Just as in the case with $M_j = 2$, the term involving the price for the single heat exchanger on the second line is $T_{j,2}^e = p_{1,2} \theta_{1,2}^2 / \theta_{h1,2}$.

The Economic Jäschke Temperature for a general line j with $M_j = 3$ heat exchangers thus becomes

$$\begin{aligned}
 T_{j,j}^e &= p_{1,j} \frac{\theta_{1,j}^2}{\theta_{h1,j}} + p_{2,j} \frac{(\theta_{2,j} - \theta_{1,j})(\theta_{2,j} + \theta_{1,j} - \frac{\theta_{1,j}^2}{\theta_{h1,j}})}{\theta_{h2,j} - \theta_{1,j}} \\
 &\quad + p_{3,j} \frac{(\theta_{3,j} - \theta_{2,j})(\theta_{3,j} + \theta_{2,j} - [(\theta_{2,j} - \theta_{1,j})(\theta_{2,j} + \theta_{1,j} - \frac{\theta_{1,j}^2}{\theta_{h1,j}})]/(\theta_{h2,j} - \theta_{1,j}))}{\theta_{h3,j} - \theta_{2,j}}. \tag{A.13}
 \end{aligned}$$

Although this expression was derived under the assumption of a constant hot stream temperature $T_{hi,j} = T_{hi,j}^{out}$, we conjecture that it is true for the case with a finite heat capacity (non-constant hot streams).

A.4. Conjecture for the general case ($M \geq 4$)

Unfortunately it was computationally not feasible to perform the elimination for the case with $M_j > 3$. From the recurring pattern, that coefficients of the previous prices appear in a fixed structure in the coefficients of the next price, we conjecture the general formula for the case with more than three heat exchangers on a line as:

$$T_{j,j}^e = \sum_{i=1}^{M_j} p_{i,j} a_{i,j} \tag{A.14}$$

where the $a_{i,j}$ is defined as

$$a_{i,j} = \frac{(\theta_{i,j} - \theta_{i-1,j})(\theta_{i,j} + \theta_{i-1,j} - a_{i-1,j})}{\theta_{hi,j} - \theta_{i-1,j}} \tag{A.15}$$

and

$$a_{0,j} = 0. \tag{A.16}$$

Table B.6
 Stream and price data for validation case study, $M_1 = 4, M_2 = 1$.

Variable	Value	Unit	Description
w_0	100	kW/°C	Heat capacity cold stream
$w_{h1,1}$	50	kW/°C	Heat capacity hot stream 11
$w_{h2,1}$	30	kW/°C	Heat capacity hot stream 21
$w_{h3,1}$	15	kW/°C	Heat capacity hot stream 31
$w_{h4,1}$	25	kW/°C	Heat capacity hot stream 41
$w_{h1,2}$	70	kW/°C	Heat capacity hot stream 12
T_0	130	°C	Cold stream temperature
$T_{h1,1}$	190	°C	Hot stream 11 temperature
$T_{h2,1}$	203	°C	Hot stream 21 temperature
$T_{h3,1}$	220	°C	Hot stream 31 temperature
$T_{h4,1}$	235	°C	Hot stream 41 temperature
$T_{h1,2}$	225	°C	Hot stream 12 temperature
$UA_{1,1}$	5	kW/°C	Heat transfer coefficient times area of Exchanger 11
$UA_{2,1}$	7	kW/°C	Heat transfer coefficient times area of Exchanger 21
$UA_{3,1}$	10	kW/°C	Heat transfer coefficient times area of Exchanger 31
$UA_{4,1}$	12	kW/°C	Heat transfer coefficient times area of Exchanger 41
$UA_{1,2}$	11	kW/°C	Heat transfer coefficient times area of Exchanger 12
$p_{1,1}$	1	USD/kW	Price for using heat from stream 11
$p_{2,1}$	1.2	USD/kW	Price for using heat from stream 21
$p_{3,1}$	1.3	USD/kW	Price for using heat from stream 31
$p_{4,1}$	1.5	USD/kW	Price for using heat from stream 41
$p_{1,2}$	1.5	USD/kW	Price for using heat from stream 12

Table B.7
 Results for validation case study, $M_1 = 4, M_2 = 1$

	Optimized	Equal Jäschke Temp.
Cost J	-3.9388	-3.9388
End Temp. T_{end}	158.7738	158.7741
Split $u = \frac{F_1}{F_0}$	0.7141	0.7152

Appendix B. Numerical validation of the case with more than 3 exchangers on a line ($M_1 = 4, M_2 = 1$)

In this section we give some numerical evidence that the general formula for the Jäschke Temperature is true for $M_j > 3$. We expect that the results when controlling the Jäschke Temperatures to equal values, will be the same as when we optimize a model which uses the arithmetic mean temperature as driving force. This will be the case when, as we conjecture, the controlled variable is equivalent to the gradient. Consider the heat exchanger network given in Fig. B.14, with the corresponding stream and price data given in Table B.6. The controlled variable is

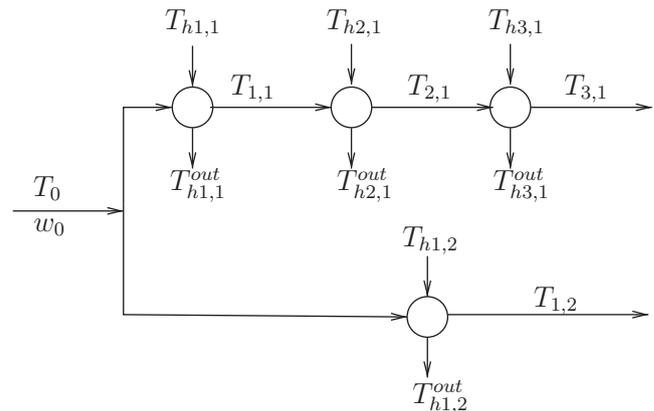


Fig. A.13. Heat exchanger network with 3 heat exchangers on the first line and one exchanger on the second line.

The cost function for the optimized case and the case using the Jäschke Temperature approach give the same values of the cost function. However, the end temperatures are not exactly

$$c = p_{1,1} \frac{\theta_{h1,1}^2}{\theta_{h1,1}} + p_{2,1} \frac{(\theta_{2,1} - \theta_{1,1}) \left(\theta_{2,1} + \theta_{1,1} - \frac{\theta_{h1,1}^2}{\theta_{h1,1}} \right)}{\theta_{h2,1} - \theta_{1,1}} + p_{3,1} \frac{(\theta_{3,1} - \theta_{2,1}) \left(\theta_{3,1} + \theta_{2,1} - \frac{(\theta_{2,1} - \theta_{1,1}) \left(\theta_{2,1} + \theta_{1,1} - \frac{\theta_{h1,1}^2}{\theta_{h1,1}} \right)}{\theta_{h3,1} - \theta_{2,1}} \right)}{\theta_{h3,1} - \theta_{2,1}}$$

$$+ p_{4,1} \frac{(\theta_{4,1} - \theta_{3,1}) \left(\theta_{4,1} + \theta_{3,1} - \frac{(\theta_{3,1} - \theta_{2,1}) \left(\theta_{3,1} + \theta_{2,1} - \frac{(\theta_{2,1} - \theta_{1,1}) \left(\theta_{2,1} + \theta_{1,1} - \frac{\theta_{h1,1}^2}{\theta_{h1,1}} \right)}{\theta_{h2,1} - \theta_{1,1}} \right)}{\theta_{h3,1} - \theta_{2,1}} \right)}{\theta_{h4,1} - \theta_{3,1}} - p_{1,2} \frac{\theta_{h1,2}^2}{\theta_{h1,2}} \tag{B.1}$$

The values from optimizing the split with fmincon (Matlab) and from using our approach are compared in Table B.7.

the same. The reasons for this discrepancy are the flatness of the optimum and numerical round-off errors, which occur due

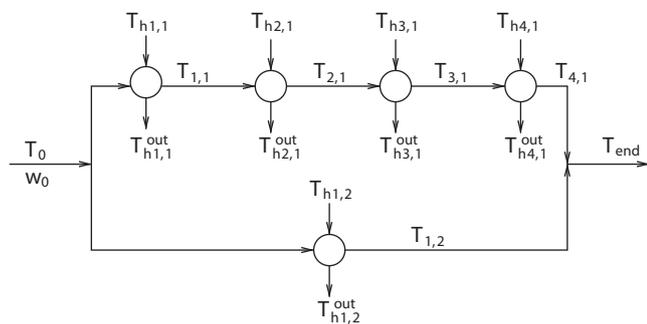


Fig. B.14. Heat exchanger network with $M_1 = 4$ and $M_2 = 1$.

to the temperature difference terms in the controlled variable. In conclusion, the numerical results for this case study strongly suggest that the conjecture is true.

References

- Aguilera N, Marchetti JL. Optimizing and controlling the operation of heat-exchanger networks. *AIChE J* 1998;44:1090–104.
- Alstad V, Skogestad S. Null space method for selecting optimal measurement combinations as controlled variables. *Ind Eng Chem Res* 2007;46:846–53.
- Alstad V, Skogestad S, Hori ES. Optimal measurement combinations as controlled variables. *J Process Control* 2009;19:138–48.
- Bonvin D, Srinivasan B, Ruppen D. Dynamic optimization in the batch chemical industry. *Chemical process control VI* 2001:255–73.
- Busé L, Mourrain B. Using the maple multires package 2003.
- Cox D, Little J, O'Shea D. Using algebraic geometry. Springer; 2005.
- Colberg R. D, Morari M. Area and capital cost targets for heat exchanger network synthesis with constrained matches and unequal heat transfer coefficients. *Comput Chem Eng* 1990;14:1–22.
- Downs JJ, Skogestad S. An industrial and academic perspective on plantwide control. *Annu Rev Control* 2011;35:99–110.
- Furman KC, Sahinidis NV. A critical review and annotated bibliography for heat exchanger network synthesis in the 20th century. *Ind Eng Chem Res* 2002;41:2335–70.
- Glemmestad B, Skogestad S, Gundersen T. Optimal operation of heat exchanger networks. *Comput Chem Eng* 1999;23:509–22.
- Grötschel M, Krumke SO, Rambau J. Online optimization of large scale systems. Springer; 2001.
- Gundersen T, Traedal P, Hashemi-Ahmady A. Improved sequential strategy for the synthesis of near-optimal heat exchanger networks. *Comput Chem Eng* 1997;21(Suppl.):S59–64.
- Halvorsen JJ, Skogestad S. Optimizing control of petlyuk distillation: understanding the steady-state behavior. *Comput Chem Eng* 1997;21:S249–54.
- Jäschke J, Skogestad S. NCO tracking and Self-optimizing control in the context of real-time optimization. *J Process Control* 2011;21:1407–16.
- Jäschke J, Skogestad S. Control structure selection for optimal operation of a heat exchanger network. In: 2012 UKACC international conference on control (CONTROL); 2012a. p. 148–53.
- Jäschke J, Skogestad S. Optimal controlled variables for polynomial systems. *J Process Control* 2012b;22:167–79.
- Jäschke J, Skogestad S.; Parallel heat exchanger control. EU/UK patent application pct/ep2013/059304 and gb1207770.7; 2012.
- Jensen JB, Skogestad S. Problems with specifying δT -min in the design of processes with heat exchangers. *Ind Eng Chem Res* 2008;47:3071–5.
- Laukkanen T, Tveit T-M, Ojalehto V, Miettinen K, Fogelholm C-J. An interactive multi-objective approach to heat exchanger network synthesis. *Comput Chem Eng* 2010;34:943–52.
- Lersbamrungskul V, Srinophakun T, Narasimhan S, Skogestad S. Control structure design for optimal operation of heat exchanger networks. *AIChE J* 2008;54:150–62.
- Leruth A. Heat exchanger network self-optimizing control – application to the Crude Unit at Mongstad Refinery [Master's thesis]. Norwegian University of Science and Technology; 2012.
- Lid T, Strand S, Skogestad S. On-line optimization of a crude unit heat exchanger network. In: Proceedings of the 6th conference on chemical process control (CPC VI); 2001. p. 476–80.
- Linnhoff B, Flower JR. Synthesis of heat exchanger networks: I. Systematic generation of energy optimal networks. *AIChE J* 1978;24:633–42.
- Linnhoff B, Hindmarsh E. The pinch design method for heat exchanger networks. *Chem Eng Sci* 1983;38:745–63.
- Marlin TE, Hrymak A. Real-time operations optimization of continuous processes. In: Proceedings of CPC V, AIChE symposium series, vol. 93; 1997. p. 156–64.
- Mathisen KW, Skogestad S, Wolff EA. Bypass selection for control of heat exchanger networks. *Comput Chem Eng* 1992;16(Suppl. 1):S263–72.
- Mills AF. Heat and mass transfer. Irwin heat transfer series; 1995.
- Morari M, Stephanopoulos G, Arkun Y. Studies in the synthesis of control structures for chemical processes. Part I: Formulation of the problem. Process decomposition and the classification of the control task. Analysis of the optimizing control structures. *AIChE J* 1980;26:220–32.
- Rodera H, Westphalen DL, Shethna HK. A methodology for improving heat exchanger network operation. *Appl Thermal Eng* 2003;23:1729–41.
- Saboo AK, Morari M. Design of resilient processing plants. IV. Some new results on heat exchanger network synthesis. *Chem Eng Sci* 1984;39:579–92.
- Saboo AK, Morari M, Woodcock DC. Design of resilient processing plants VIII. A resilience index for heat exchanger networks. *Chem Eng Sci* 1985;40:1553–65.
- Skogestad S. Plantwide control: the search for the self-optimizing control structure. *J Process Control* 2000;10:487–507.
- Skogestad S. Chemical and energy process engineering. CRC Press; 2008.
- Srinivasan B, Bonvin D. Dynamic optimization under uncertainty via NCO tracking: a solution model approach. In: BatchPro symposium; 2004. p. 17–35.
- Yee TF, Grossmann IE. Simultaneous optimization models for heat integration—II. Heat exchanger network synthesis. *Comput Chem Eng* 1990;14:1165–84.