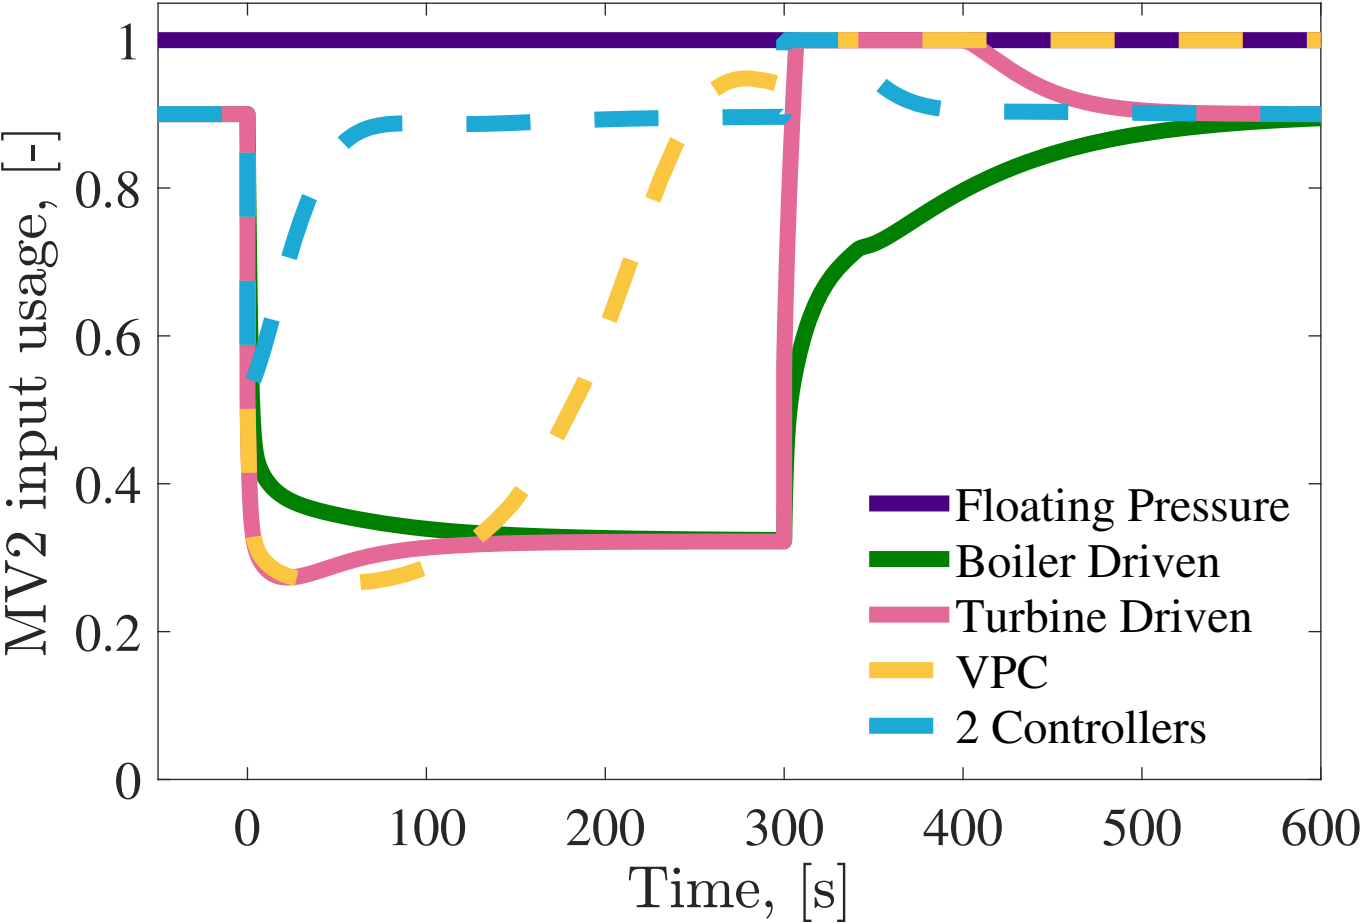
MV2 input usage, [-]
Time, [s]
1
0.8
0.6
0.4
0.2
0
0
100
200
300
400
500
600
Floating Pressure
Boiler Driven
Turbine Driven
VPC
2 Controllers