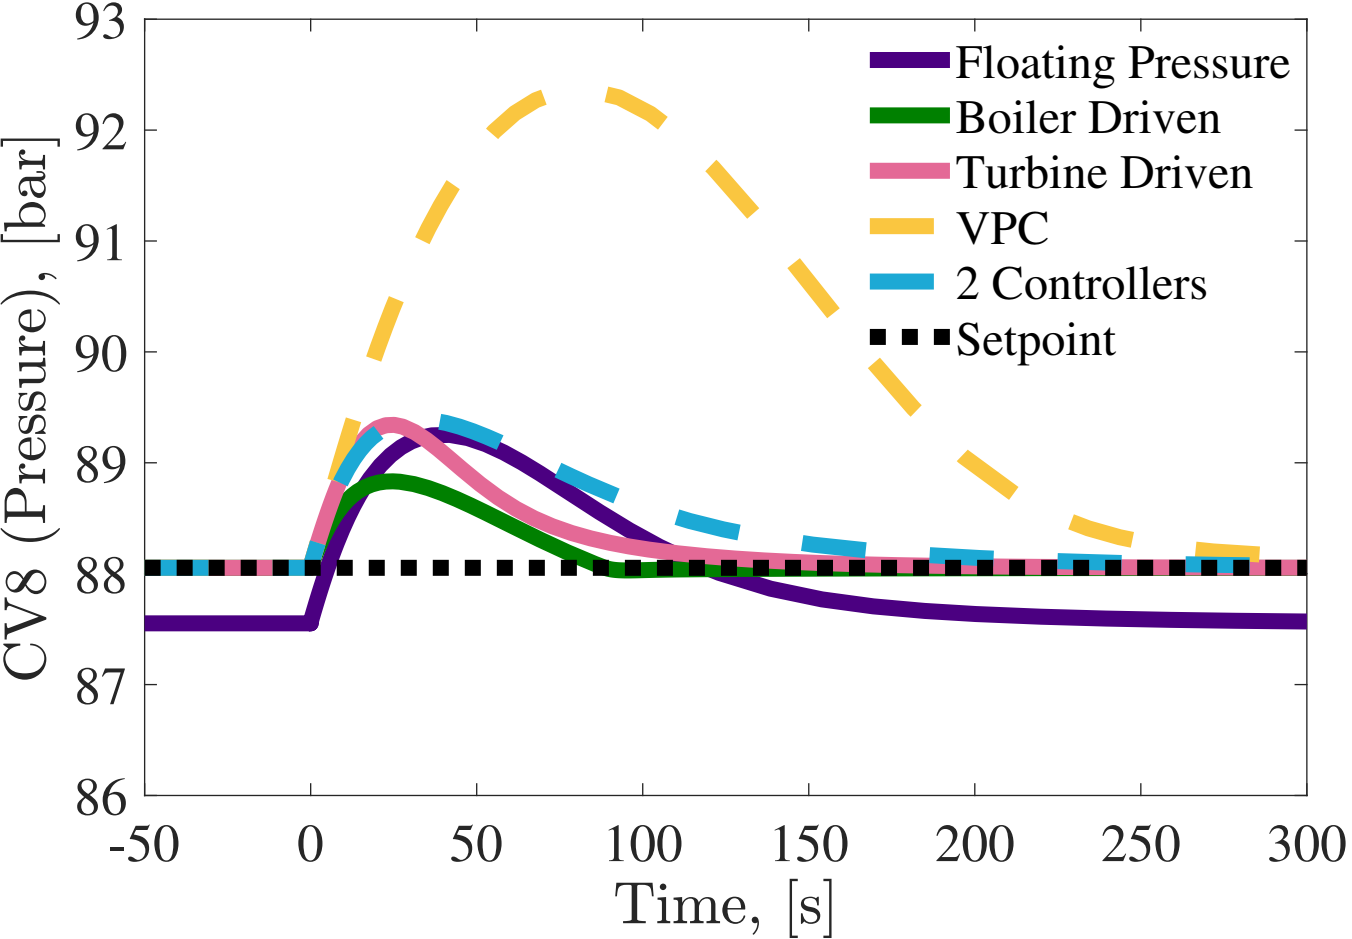
Floating Pressure
Boiler Driven
Turbine Driven
VPC
2 Controllers
Setpoint
CV8 (Pressure), [bar]
Time, [s]
93
92
91
90
89
88
87
86
-50
0
50
100
150
200
250
300