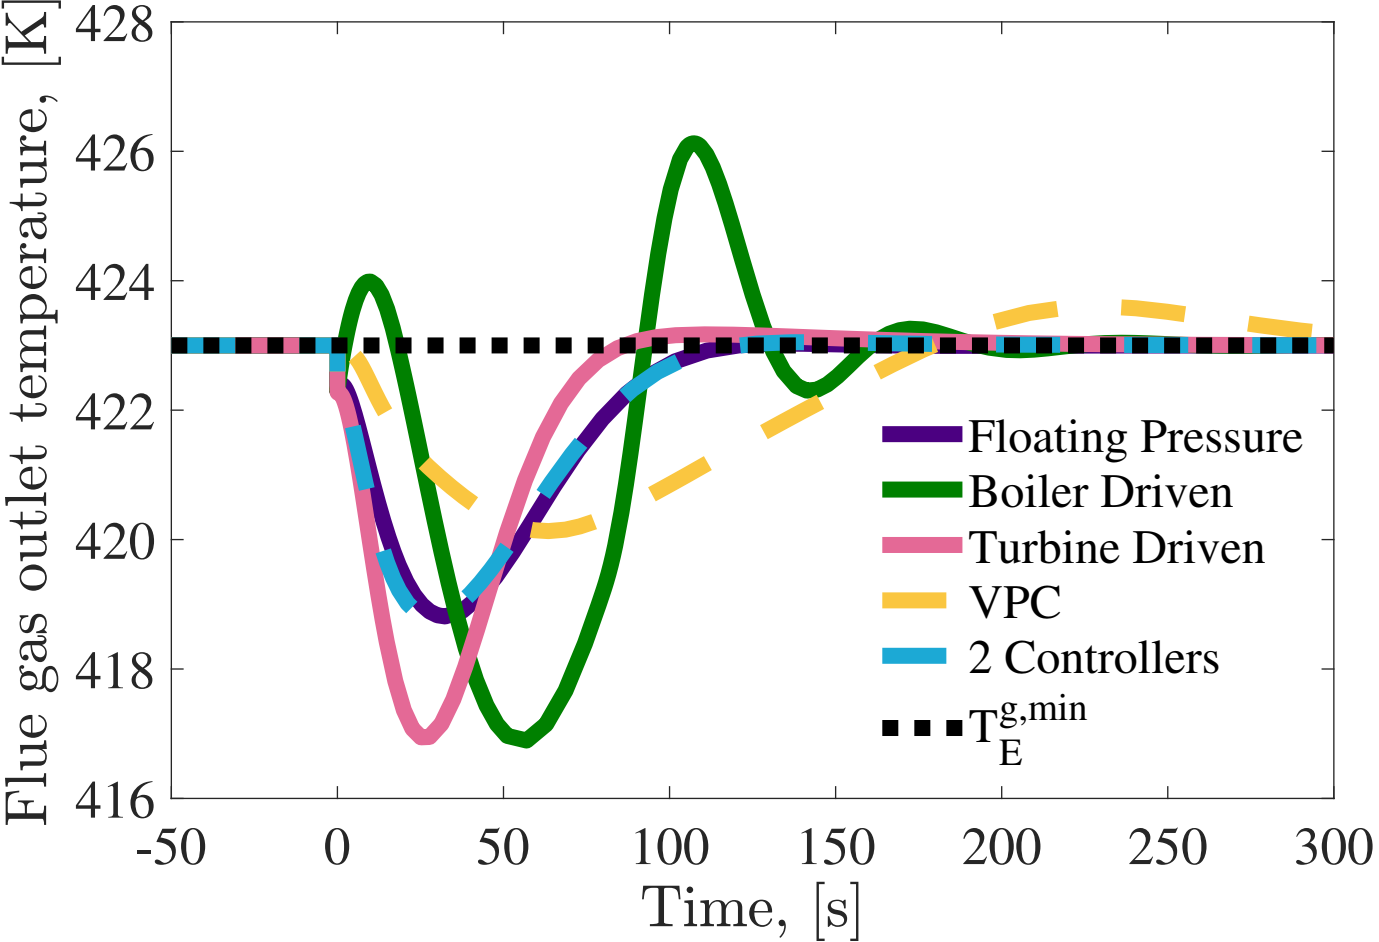
Flue gas outlet temperature, [K]
428
426
424
422
420
418
416
-50
0
50
100
150
200
250
300
Time, [s]
Floating Pressure
Boiler Driven
Turbine Driven
VPC
2 Controllers
$T_E^{g,min}$